

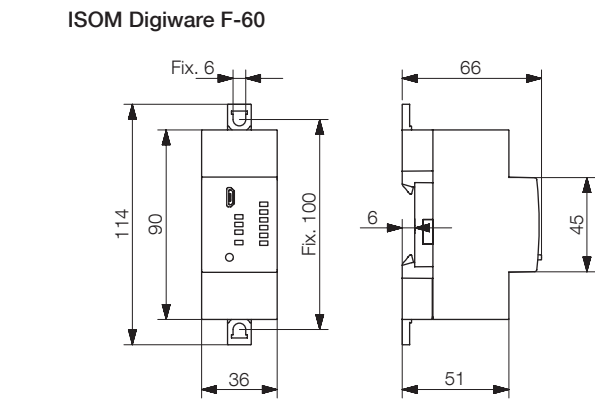


Insulation Monitoring
Device & Locating
Current Injector
L-60 / **4729 0110**
L-60t / **4729 0111 (*)**
L-60h / **4729 0112 (**)**

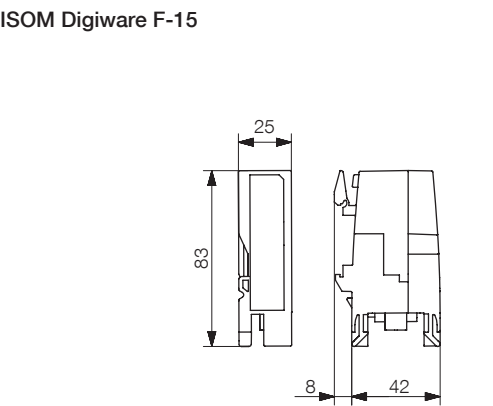

6 channels
Insulation Fault Locator
F-60 / **4729 0126**
F-60t / **4729 0127 (*)**

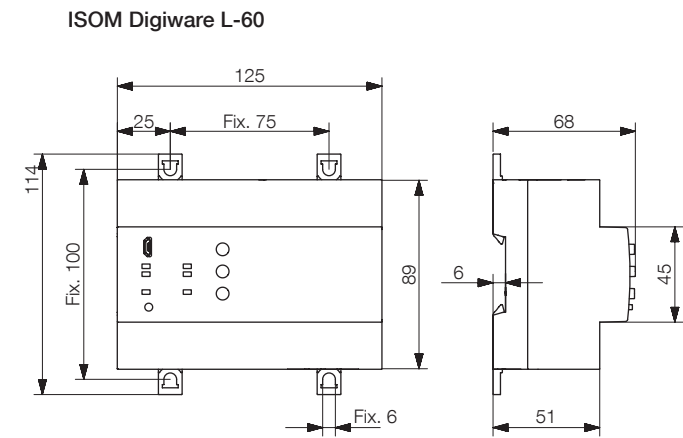

Differential
CT Adaptor
T-15 / **4729 0590**
T-15t / **4729 0591 (*)**

(*) t -> tropicalized & reinforced against vibration & shocks / (**) h -> for medical locations


ISOM Digiware

Insulation monitoring and measurement
system for IT earthing system network

Full user manual:
[www.socomec.com/
operating-instructions](http://www.socomec.com/operating-instructions)
www.socomec.com



- 1 Use **RJ45 Digiware Bus cables** (UTP RJ45 straight, twisted pairs, unshielded, AWG24, 300V, cat.III. rated, -20 / +70 °C) between all DIRIS Digiware modules.
- Do not connect **RJ12 sensor cable** to **RJ45 Digiware Bus connector** to avoid any risk of mechanical damage of this connector.

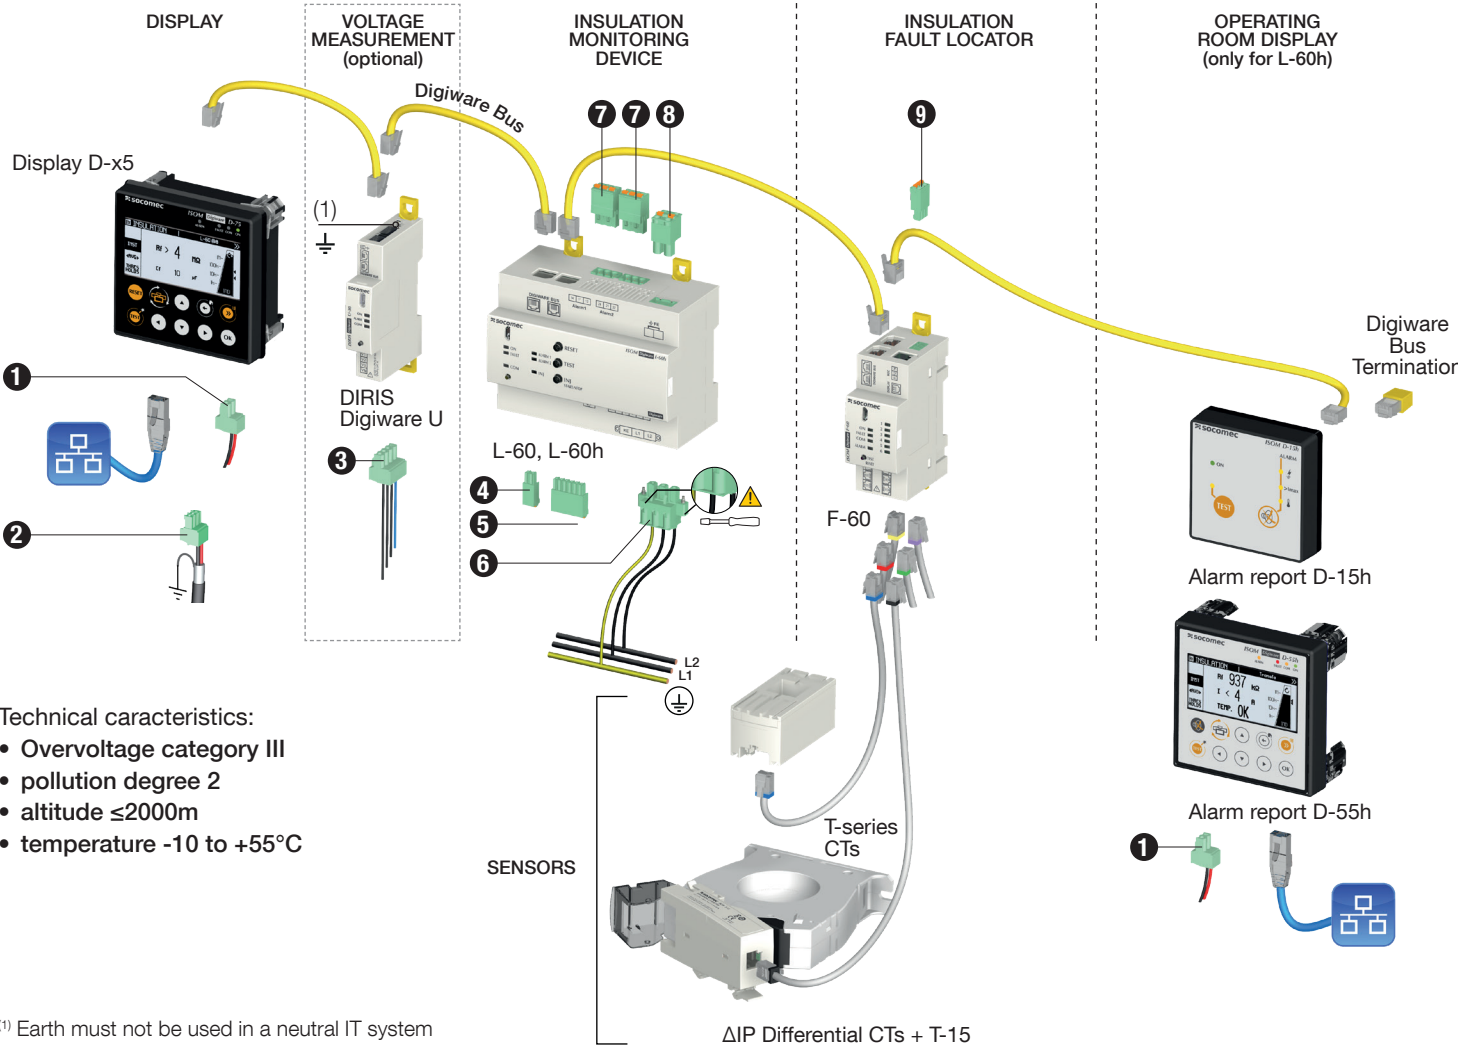


Parts listed are considered as SELV (safety extra low voltage): **1, 2, 4, 5, 8, 9, 11**

	1 Supply 24VDC	2 COM RS485 Modbus	3 U inputs 50-300VAC Ph/n	4 1x PTC (T°C) input Ref.: 48290560	5 4x I/O Output: 12-24VDC Min 600Ω 40 mA max Input: Max 100Ω	6 U/PE inputs L-60: 24-480VAC L/N (standard & t version) 24-480VAC L/L' (standard & t version) 24-480VDC +/- (standard & t version) 24-250VAC L/N or L/L' (h version)	6 U/PE inputs L-60h: 24-250 VAC/ VDC Ph/Ph	7 2x Digital outputs 250VAC - 1A max 2x Relay 250VAC - 3A max or 30VDC - 1A max	8 Functional Earth (FE) input	9 1x Digital outputs 24VDC - 1A max
	••	•••	••••	••	•••••	•••	•••	•••	••	•••
	0.2 - 2.5 mm ² x= 7 mm	0.14 - 1.5 mm ² x= 7 mm	0.2 - 2.5 mm ² x= 7 mm	0.2 - 1.5 mm ² x= 10 mm	0.2 - 1.5 mm ² x= 10 mm	0.2 - 2.5 mm ² x= 10 mm	0.2 - 2.5 mm ² x= 10 mm	0.2 - 2.5 mm ² x= 10 mm	0.2 - 2.5 mm ² x= 10 mm	0.14 - 1.5 mm ² x= 7 mm
Nm max.	0.25	0.25	0.25	-	-	-	-	-	-	-


2 Supply / Communication

ISOM Digiware D-x5




3 Main networks connections and loads

Each current input setting is individual and can be mixed (CT and/or differential CT). See below some examples: (for full PMD function refer to DIRIS Digiware Quickstart Datasheet)




ISOM Digiware F-60


3AC+N / IMD + IFL + upstream load current monitoring

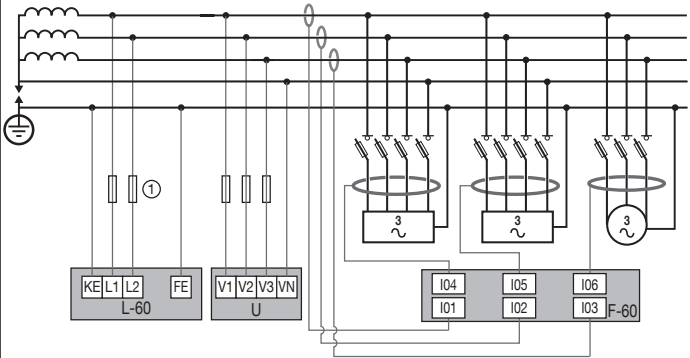


3AC / IMD + IFL + load current monitoring

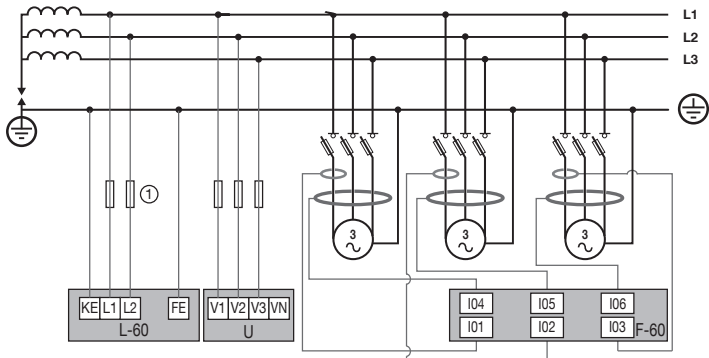


3AC / IMD + IFL

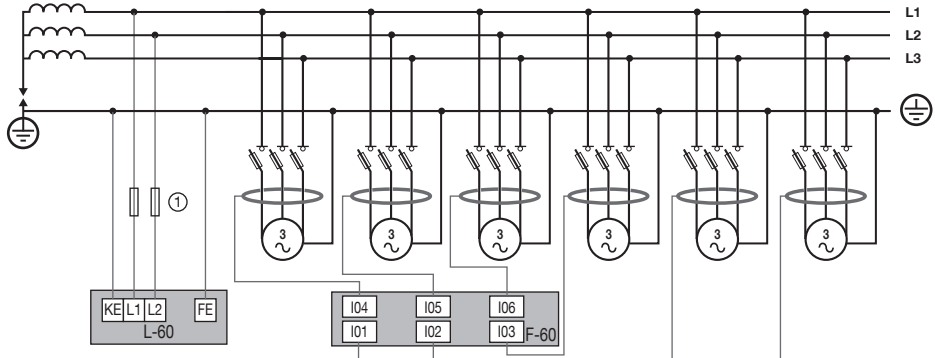

DC / IMD + IFL

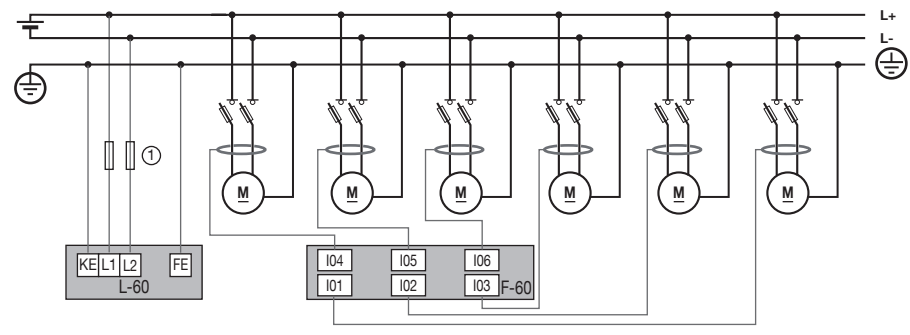

AC / IMD + IFL

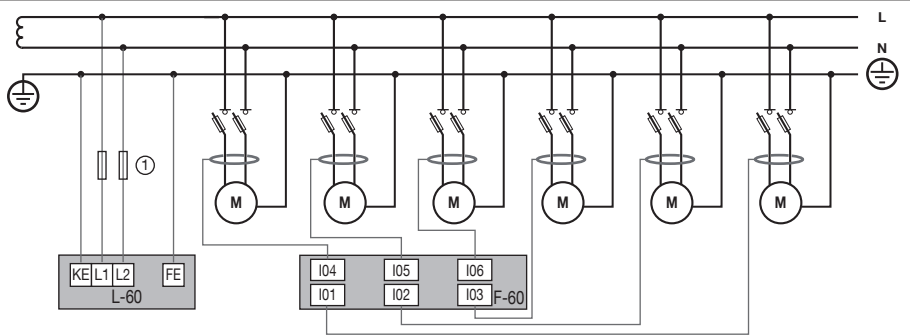


4 Current sensors & adapter T-15


Important:

- Use only RJ12 SOCOMEC current Sensors cable (type RJ12 straight, twisted pairs, unshielded, 300V cat. III. rated, -40 / +85°C).
- It is recommended to mount all the current sensors with the same orientation.
- Always start with current sensor input 1.
- If mounted on T-15: no mounting of T-15 on DIN-rail
- RJ12 max length: 10m


STEP 1

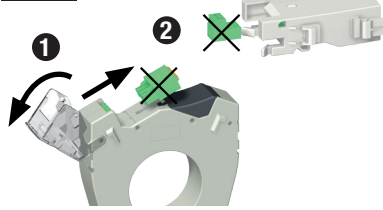


STEP 2

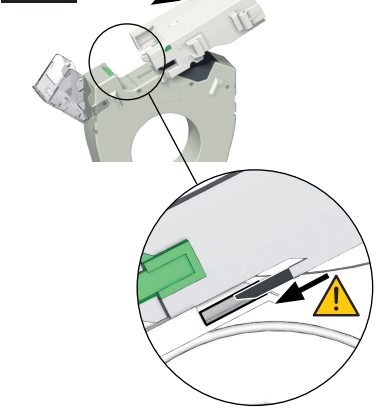


Wiring ISOM Digiware T-15 on differential CTs ΔIP (T-15 : no mounting on busbars !)

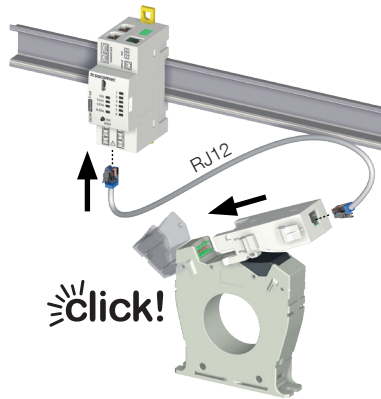

Wiring ISOM Digiware T-15 on existing differential CTs (T-15 : no mounting on busbars !)

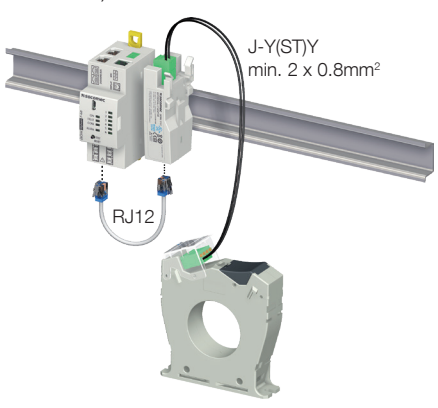

ISOM Digiware F-60

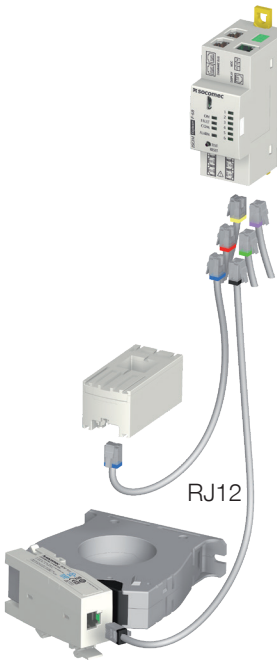


6x Current sensors TE / TR / TF or differential CTs ΔIP


5 Configuration

Easy Config Software

Ethernet

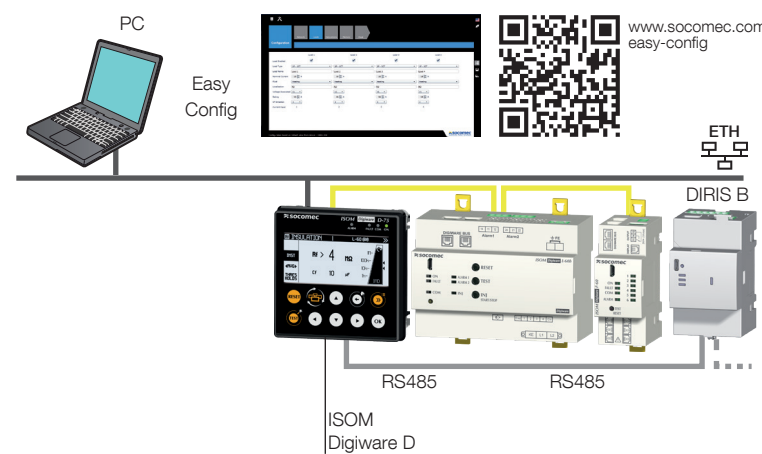

USB

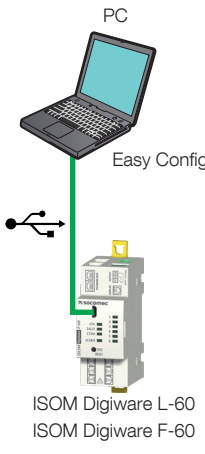

Display ISOM Digiware

Digiware Bus

